



LOCATION PLAN 1:1250




LICENCE DRAWING KEY

LICENCE DRAWING KEY		FIRE AUTHORITY REQUIREMENTS	
	AMBIT OF LICENSED PREMISES		HALF HOUR FIRE RESISTANT WITH SMOKE SEALS & INTUMESCENT STRIPS
	CUSTOMER AREA (INC BARS) (For Licensing Activities)		ONE HOUR FIRE RESISTANT WITH SMOKE SEALS & INTUMESCENT STRIPS
	KITCHEN & STAFF AREAS		VISION PANEL
	TOILETS & PASSAGEWAYS		PANIC BOLT
	LIQUOR STORE		SELF-CLOSING
			SELF-CLOSING AUTOMATIC RELEASE
			FUSIBLE LINK
			DOOR SELECTOR
			SPY HOLE
			FIRE DOOR KEEP SHUT 10mm LETTERS TO BOTH SIDES OF DOOR LEAF


	FIRE DOOR KEEP LOCKED 10mm LETTERS TO BOTH SIDES OF DOOR LEAF		DRY POWDER EXTINGUISHER
	FIRE ESCAPE KEEP CLEAR 10mm LETTERS TO BOTH SIDES OF DOOR LEAF		FOAM FIRE EXTINGUISHER
	FIRE EXIT 20mm LETTERS		ALARM WARNING DEVICE
	PUSH BAR TO OPEN 20mm LETTERS		ALL WALLS AND PARTITIONS TO BE MINIMUM HALF HOUR FIRE RESISTANT
	DIRECTIONAL ARROW (GREEN)		EMERGENCY LIGHTING TO COMPLY WITH BS 5266 PART 1
	FIRE RESISTING GLAZING ELEMENT		FIRE SAFETY RELATED SIGNS AND NOTICES TO COMPLY TO BS 5499
	ILLUMINATED SUSPENDED "FIRE EXIT" SIGN 75mm LETTERS		FIRE FIGHTING EQUIPMENT TO COMPLY WITH BS 5306 WALL AND CEILING LININGS ARE TO BE CLASS 1 SURFACE SPREAD OF FLAME (AS DEFINED BY BS 476
	AREA COVERED BY ESCAPE LIGHTING		CLASS 0 IN ESCAPE ROUTES
	AREA COVERED BY SMOKE DETECTORS		UPHOLSTERED SEATING FURNITURE TO SATISFY THE FOLLOWING :-
	AREA COVERED BY HEAT DETECTORS		*IGNITION SOURCE (CIGARETTE TEST) AS SPECIFIED IN BS5852 PART 1
	FIRE ALARM CALL POINT		FIRE TEST FOR FURNITURE: METHODS OF TEST FOR THE IGNITABILITY BY SMOKERS.
	FIRE ALARM INDICATOR PANEL		
	FIRE BLANKET IN CONTAINER		
	CARBON DIOXIDE FIRE EXTINGUISHER		
	9 LITRE WATER EXTINGUISHER		

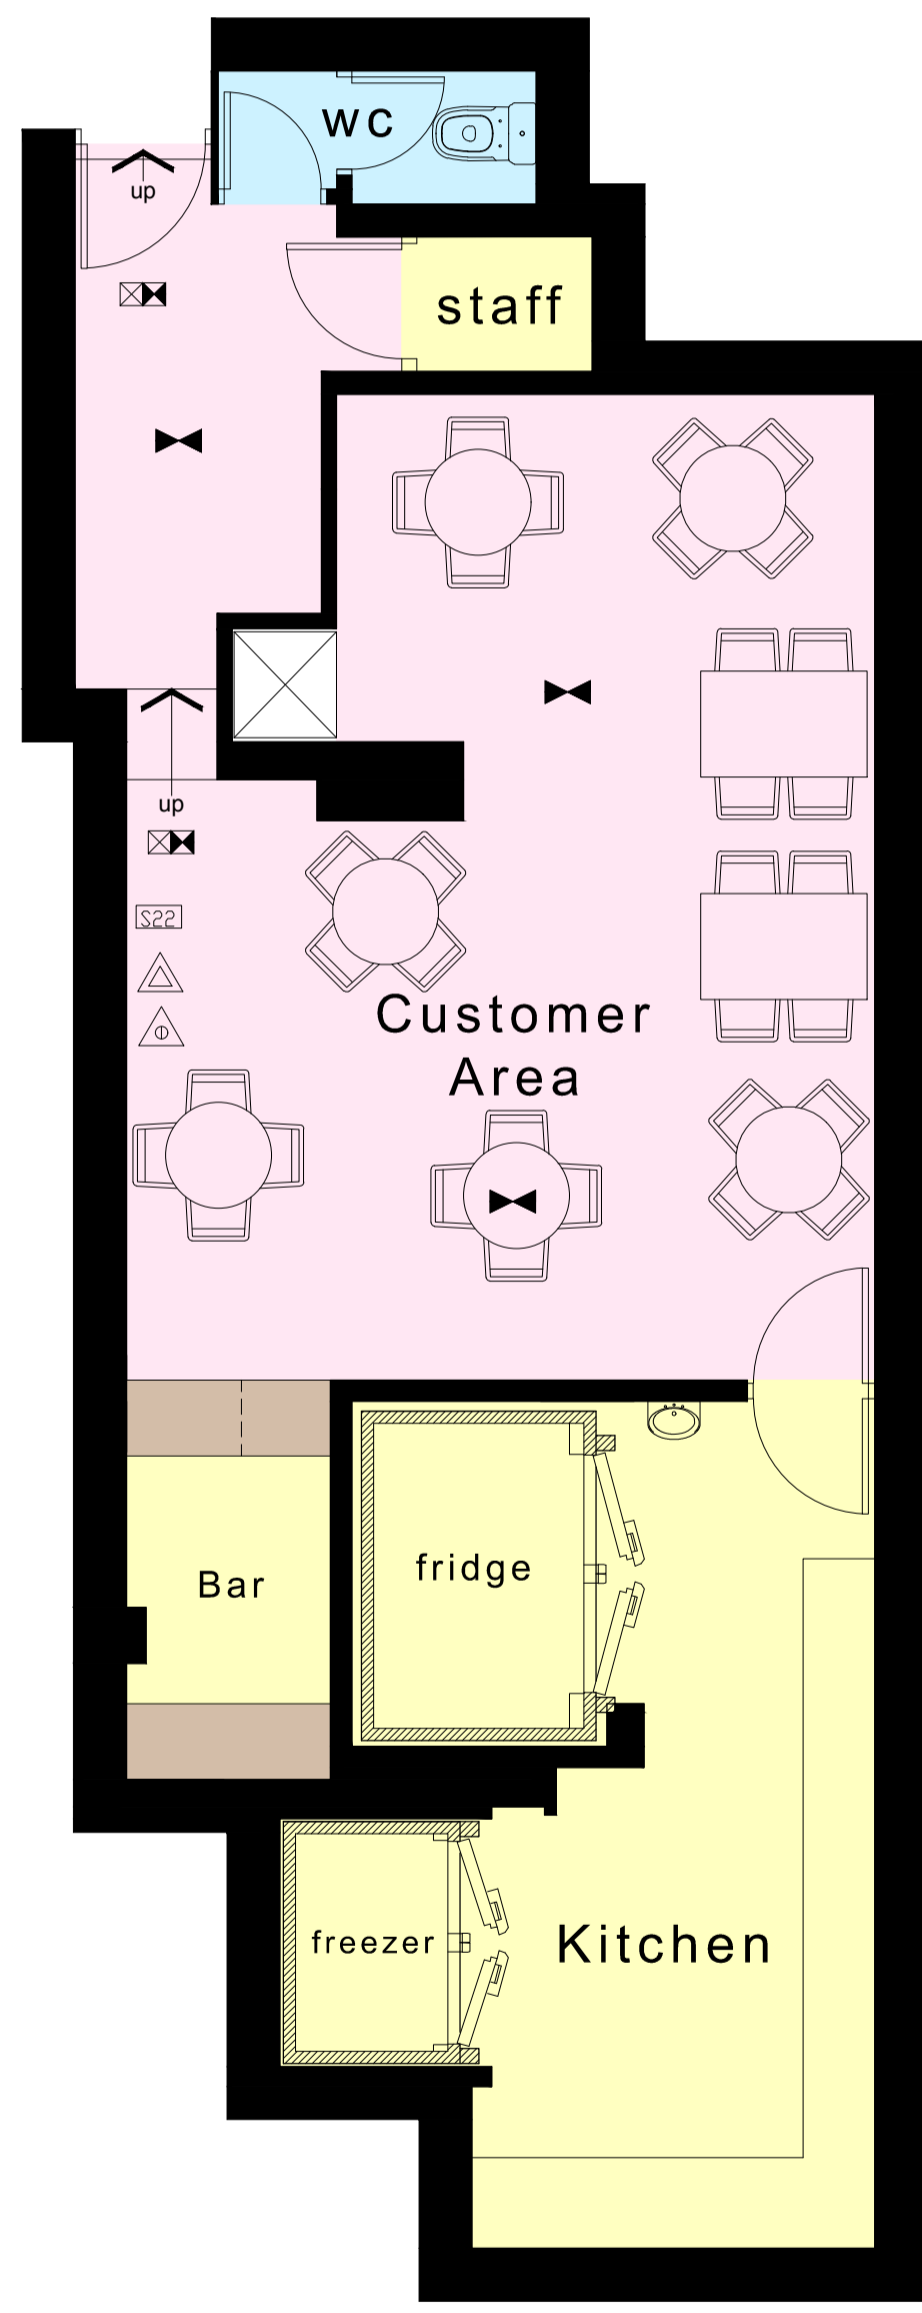

BASEMENT FLOOR PLAN 1:50

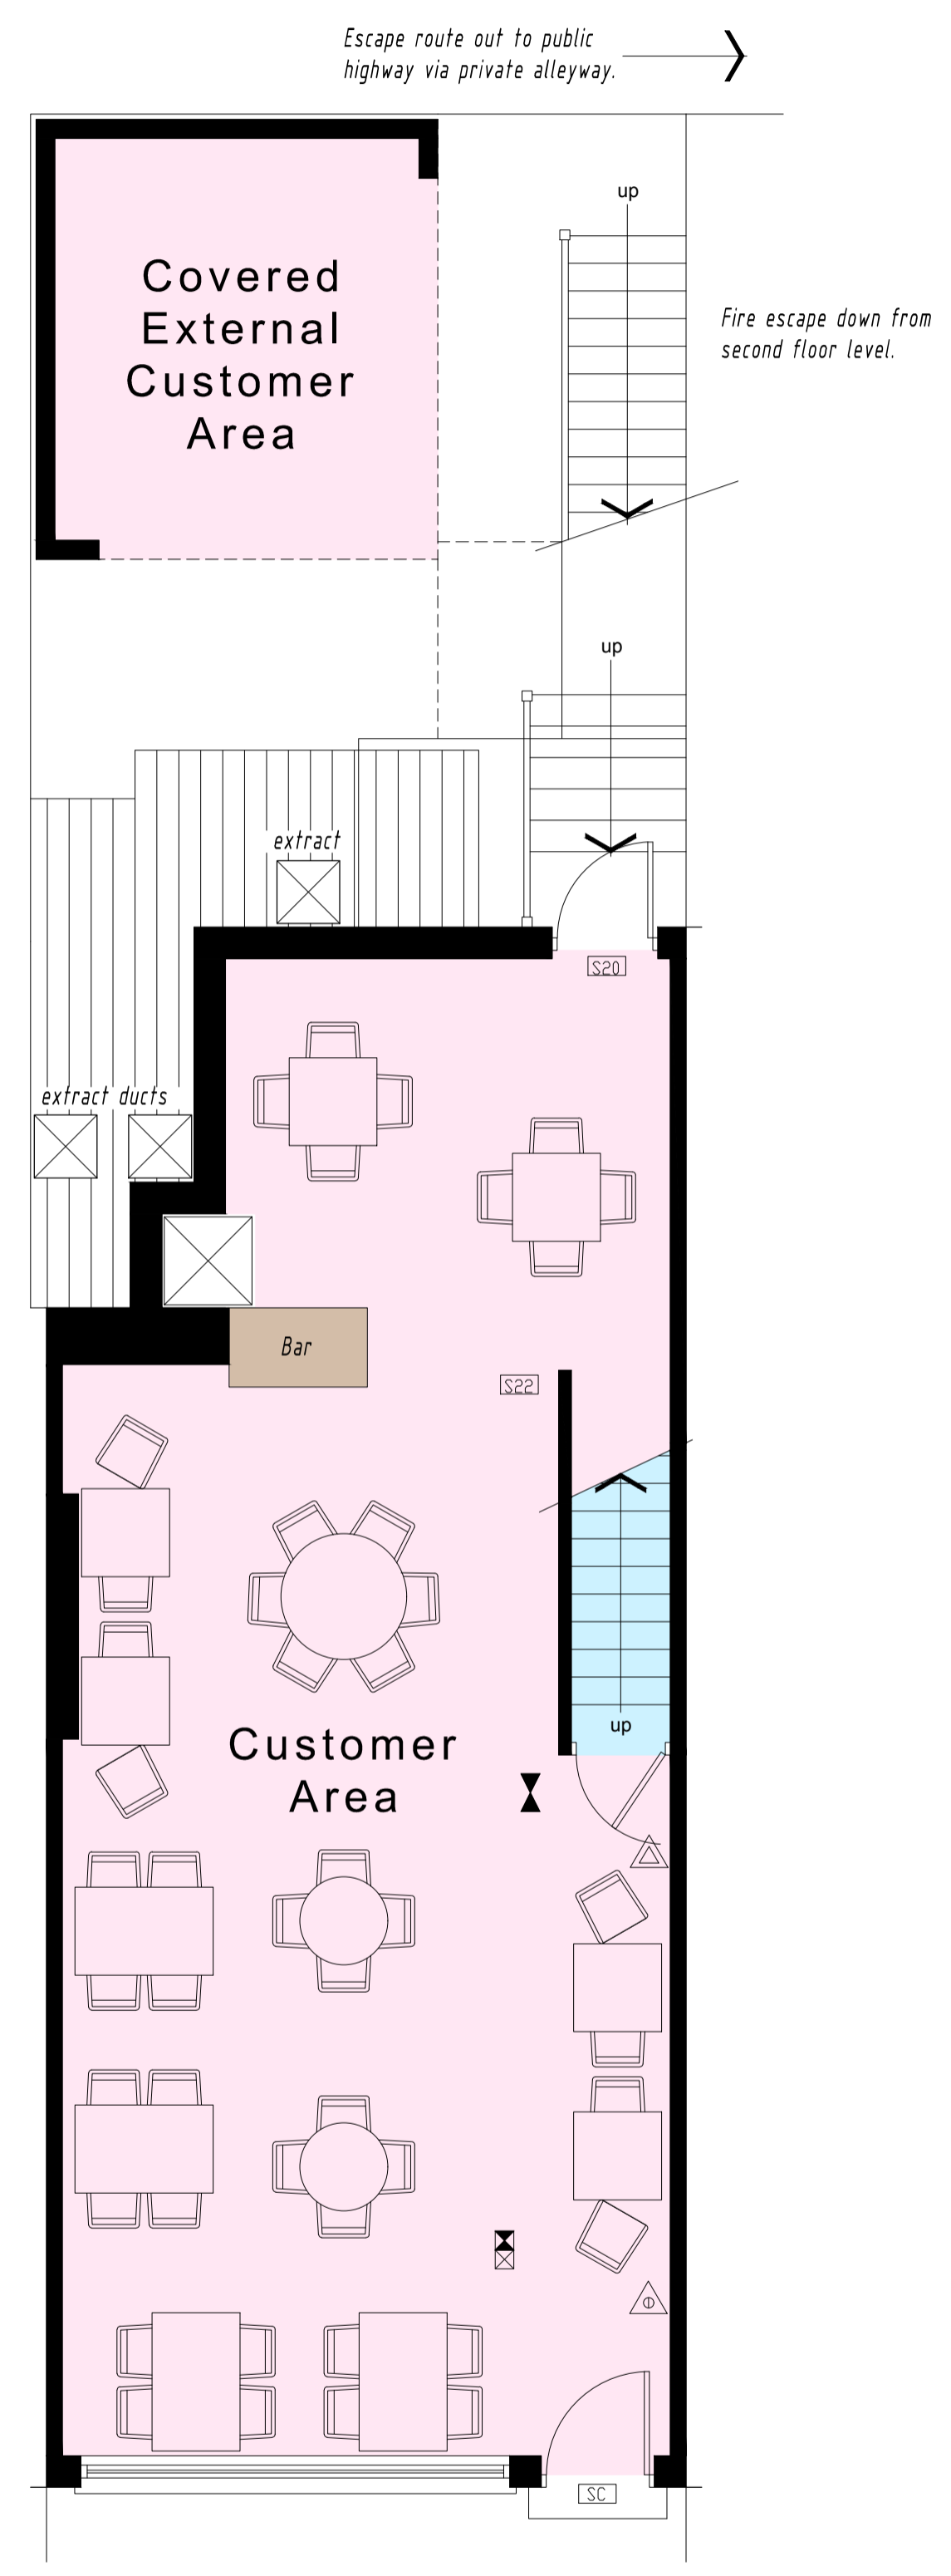

GROUND FLOOR PLAN 1:50

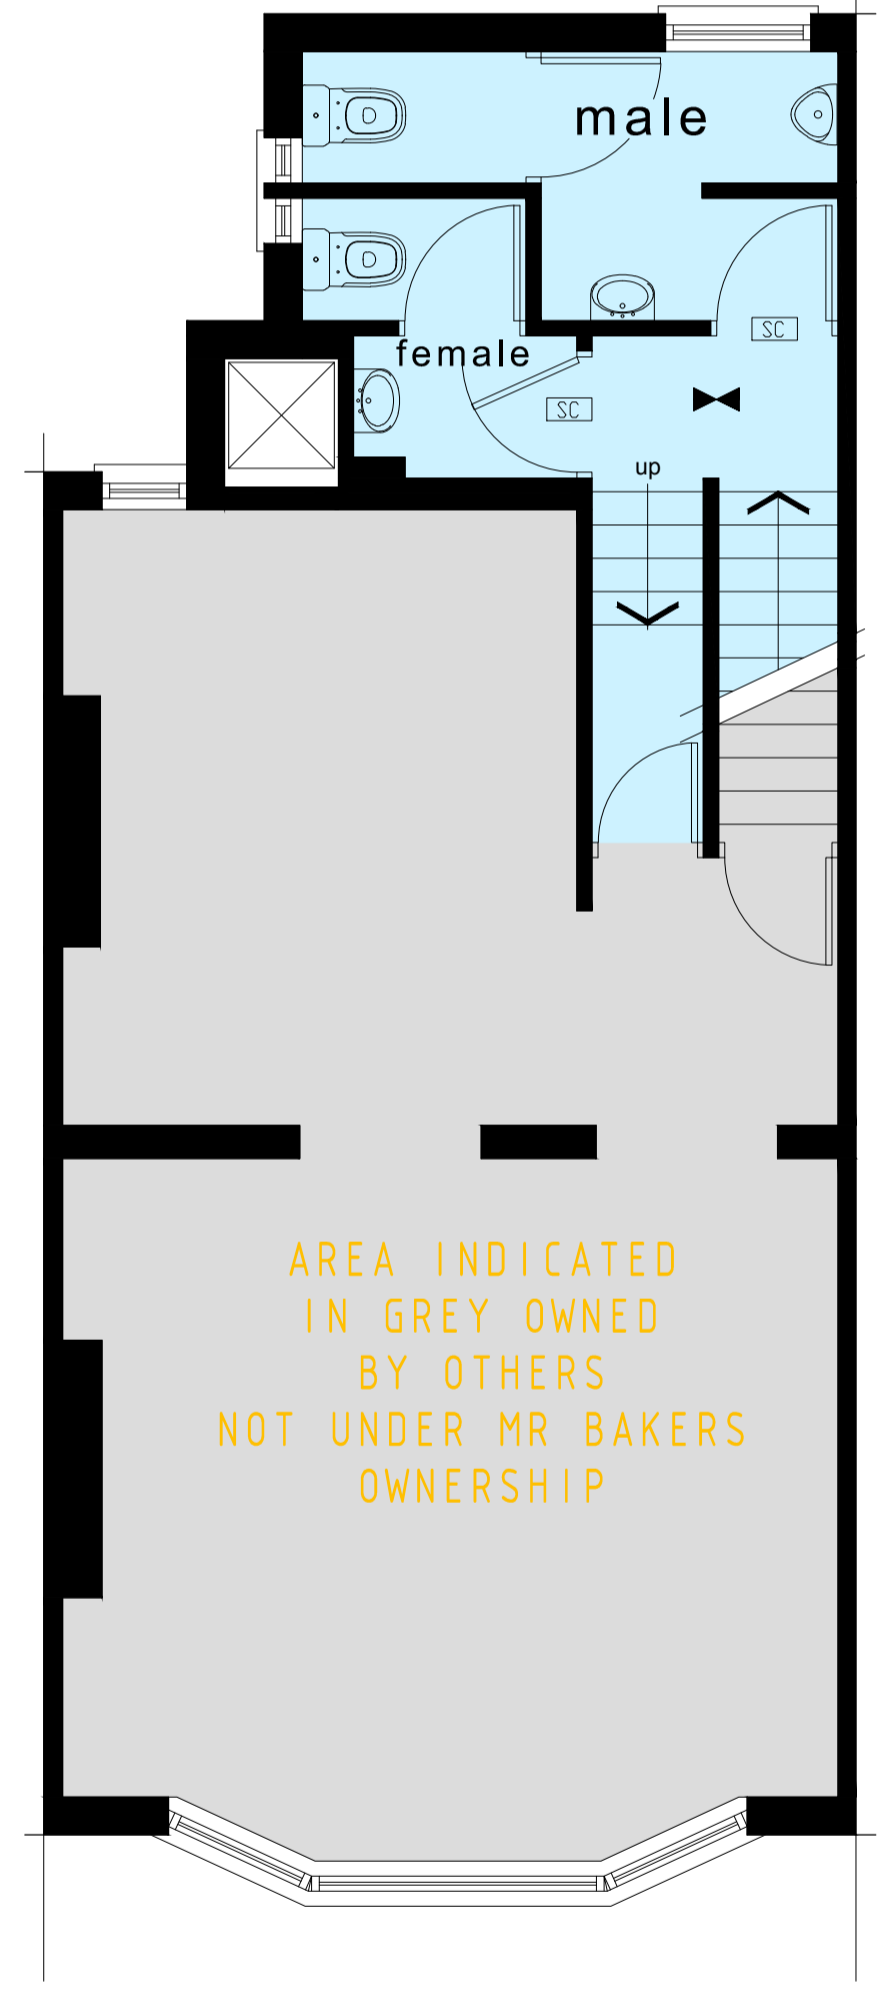

FIRST FLOOR PLAN 1:50

Client:
 Mr O Baker
 Location:
 Twelve Bar
 12 Cliff Town Road
 Southend on Sea
 Essex SS1 1AB
 Project:
 LICENCE DRAWING
 Floor + Location Plans
 Drawn:
 Scale: VARIOUS
 Drawing No: 22.106/L01
 Checked:
 Date: January 2022
 Rev: B

